


Monroe County Transportation Authority  
 Date August 10th, 2020

12  
 7  
 3  
 1

TYPE	DESCRIPTION	MANUFACTURER	CATALOG #	LAMP TYPE	MAX WATT	VOLTS	MOUNTING	REMARKS
A	WET LOCATION LOW BAY LED FIXTURE	HOLOPHONE	FLED2-12L-4K-12-UN-NA-CRW-LS	LED	129	120V	PENDANT - 15' A.F.F.	W/ FIXTURE MOUNTED ON OFF-DIMMING/PHOTOCELL SENSOR.
X	BATTERY PACK W/ 2 HEADS - NEMA 4X RATED	EVENLITE	DXM2-LED	LED	7	120V/12VDC	WALL	W/ (2) 7 WATT LED LAMP HEADS. CAPACITY FOR REMOTE HEADS WHERE APPLICABLE
X1	EXT SIGN - NEMA 4X RATED	EVENLITE	TWL-EM-R-LLW-SD	LED	4	120V/12VDC	WALL	
X2	DUAL REMOTE HEADS - NEMA 4X RATED	EVENLITE	PRW-LED-2MM	LED	-	12VDC	WALL	

LIGHTING FIXTURE SCHEDULE

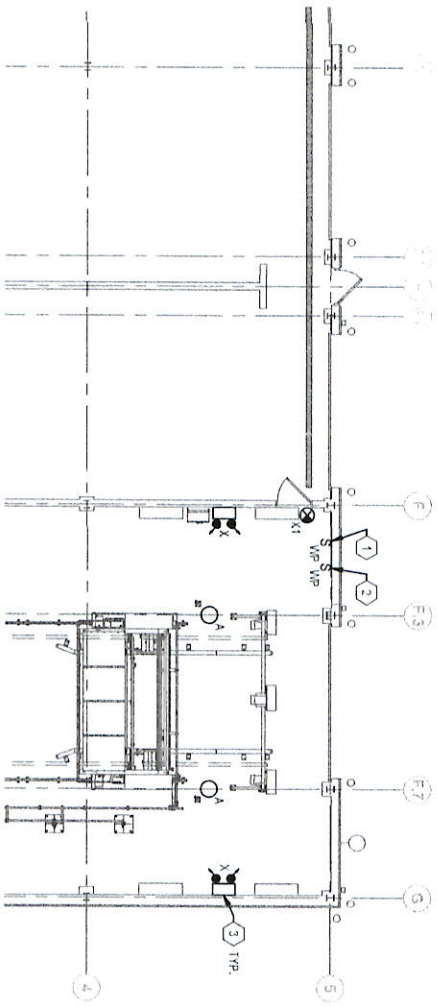

DRAWING NOTES:

- 1 NEW LIGHT SWITCH FOR EXISTING WALL MOUNTED FIXTURES. INTERCEPT CIRCUIT AND CONNECT THROUGH SWITCH FED FROM NEARBY PANEL. BWI, CONNECT WITH 2#10, #10080D, IN 3/4" C.
- 2 NEW LIGHT SWITCH FOR NEW PENDANT MOUNTED A FIXTURES. UTILITY 2#10, #10080D IN 3/4" C. FOR NEW A FIXTURES AND FEED FROM NEW 200T CIRCUIT BREAKER IN PANEL. BWI
- 3 CONNECT NEW WALL MOUNTED EMERGENCY LIGHTING TO UNSWITCHED PORTION OF LIGHTING CIRCUIT USED FOR NEW OVERHEAD A LIGHTS. CONNECT NEW EMERGENCY FIXTURES WITH 2#10, #10080D IN 3/4" C.

DESIGN SERVICES

WATER, PA 18370

RTATION AUTHORITY

